


DUAL LITE

Performance Guarantee



Dual-Lite guarantees the LiteScape unit will fully meet the 2003 edition of the NFPA 101 Life Safety Code emergency lighting requirements by providing an average of one footcandle of illumination along the path of egress as defined in the illustration below.

Center to Center Mounting Information

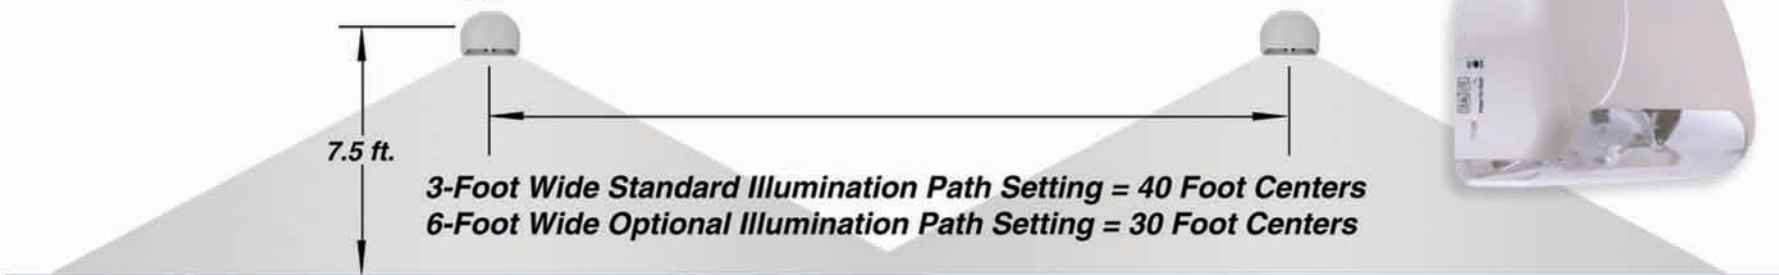

NOTE: The LiteScape unit must be installed per factory instructions provided and properly maintained. In addition, the pathway to be illuminated must meet the minimum surface reflectance values shown at right to qualify for guaranteed illumination performance.

Minimum Reflectance Values Required:		
Ceiling: 80%	Walls: 50%	Floor: 20%

The LiteScape Performance Guarantee applies solely to units mounted 7.5 feet above the floor surface. For information on lighting performance at other mounting heights, refer to LiteScape Series Mounting Guide on the LiteScape product page in the Dual-Lite web site's on-line catalog. The LiteScape Performance Guarantee is subject to all conditions as outlined in the Product Warranty Statement on the Dual-Lite public web site (www.dual-lite.com) and applies only to the installation's initial emergency lighting inspection by the authority having jurisdiction.